

## Stochastic Integrated Market for Electric Power and Natural Gas Systems

Ordoudis, Christos; Pinson, Pierre; Morales González, Juan Miguel

*Publication date:*  
2016

*Document Version*  
Publisher's PDF, also known as Version of record

[Link back to DTU Orbit](#)

*Citation (APA):*

Ordoudis, C., Pinson, P., & Morales González, J. M. (2016). Stochastic Integrated Market for Electric Power and Natural Gas Systems. Poster session presented at 3rd General Consortium Meeting of the CITIES project, Lyngby, Denmark.

### DTU Library

Technical Information Center of Denmark

---

#### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal


If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

# Stochastic Integrated Market for Electric Power and Natural Gas Systems

Christos Ordoudis, Pierre Pinson, Juan M. Morales

Technical University of Denmark


## Introduction

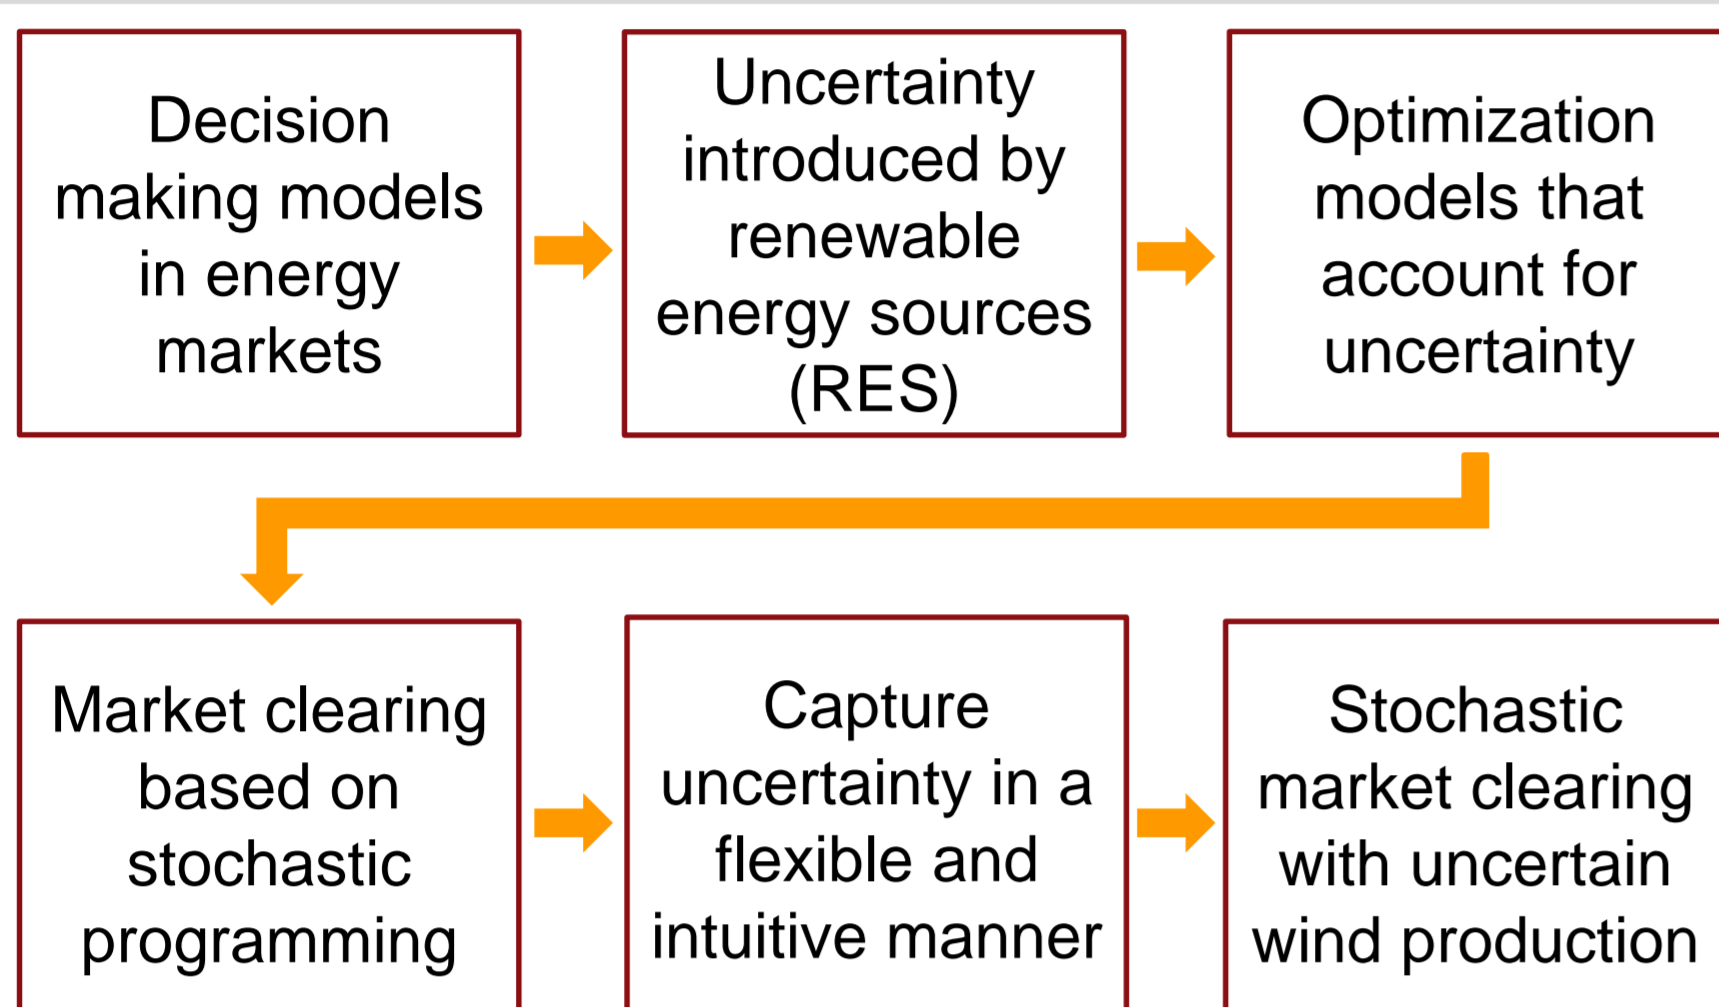

## Energy System Integration

### Aim

- Efficiently align existing synergies towards the optimal operation of energy systems.
- Propose **new market structures** to provide adequate incentives to all market participants.
- Manage high **uncertainty** on both supply and demand sides.

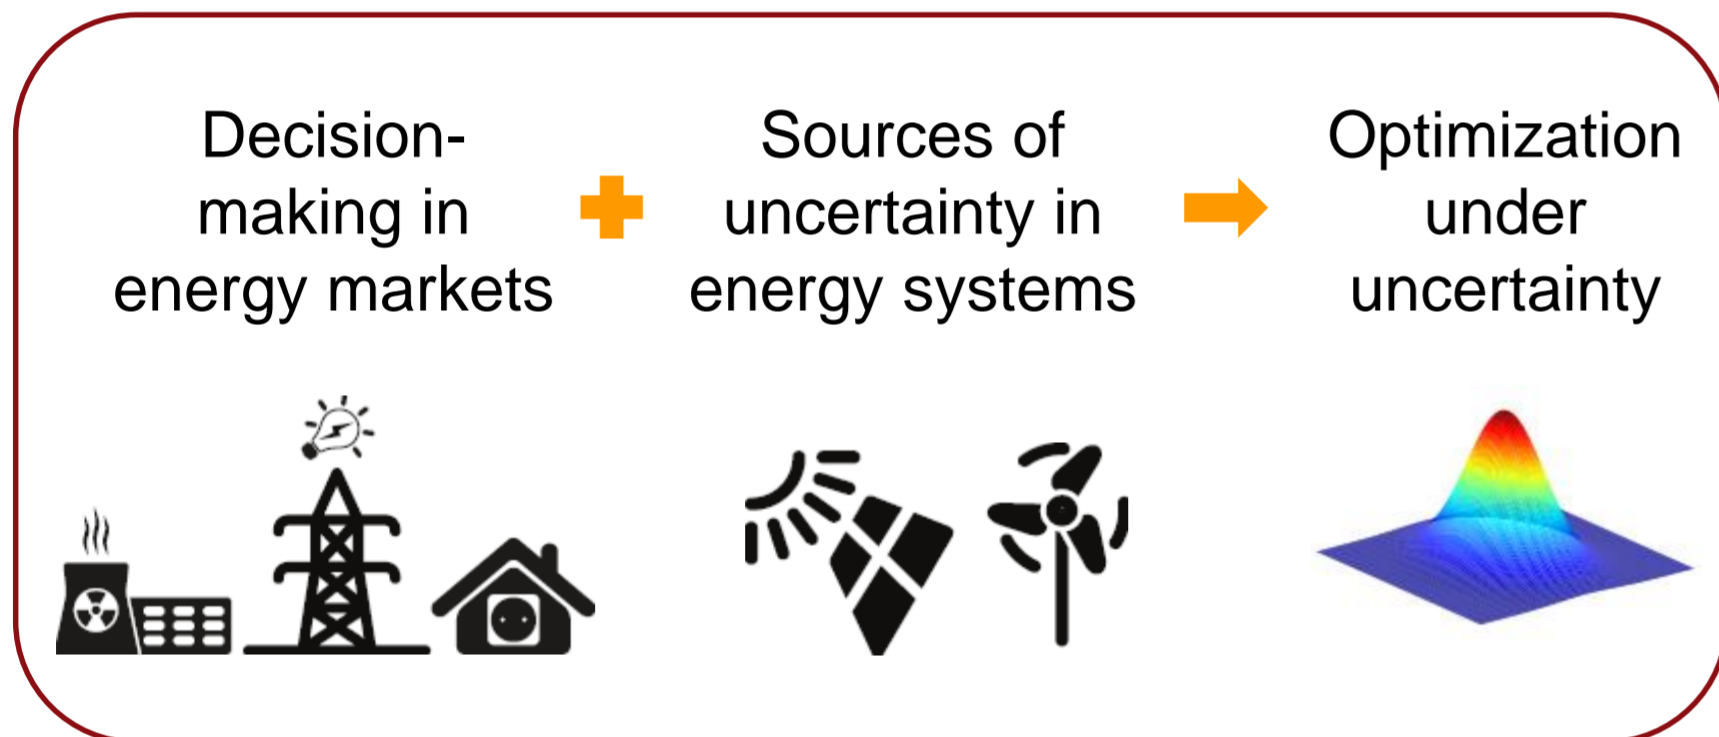

### Electricity and Natural Gas

**Strong link** between the electricity and natural gas systems is increased by integration of **renewable energy sources** and the need for flexible reserves provided by GFPPs.

## Market Clearing Approaches



### Conventional market clearing

#### Sequential clearing of two trading floors:

- Day-ahead market is cleared based on deterministic description of uncertain wind power production.
- A balancing market is cleared for real-time operation.



### Stochastic market clearing

#### Co-optimization of two trading floors:


- Day-ahead dispatch is determined by co-optimizing day-ahead and real-time dispatch, where wind power uncertainty is probabilistically described.
- A balancing market is cleared for real-time operation.

GFPPs: Gas-fired power plants  
NG: Natural gas  
LMP: Locational marginal price

## Electricity and Natural Gas Markets


### Decoupled Approach

- Economic dispatch of electricity system is solved and the NG consumption of GFPPs is determined.
- Economic dispatch of natural gas system is solved.

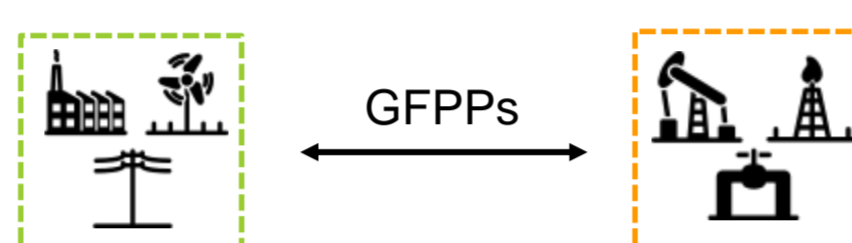

### Integrated Approach

Simultaneously solve the economic dispatch of electricity and natural gas systems.

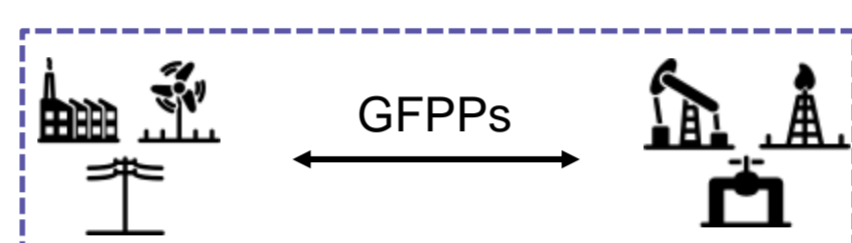

## Optimization Models

The following models are used to determine the day-ahead dispatch of the electricity and natural gas systems.

### Conventional – Decoupled

**Minimize**  
Day-ahead electricity cost.

**Subject to**

- Day-ahead operating constraints of electricity system.
- Wind power is constrained by its expected value.

↓  
GFPPs NG consumption is determined.

**Minimize**  
Day-ahead natural gas cost.

**Subject to**

- Day-ahead operating constraints of natural gas system.

### Conventional – Integrated

**Minimize**  
Day-ahead electricity and natural gas cost.

**Subject to**

- Day-ahead operating constraints of electricity and natural gas systems.
- Wind power is constrained by its expected value.

### Stochastic – Integrated

**Minimize**  
Day-ahead electricity and natural gas cost + expected electricity and natural gas balancing cost.

**Subject to**

- Day-ahead operating constraints of electricity and natural gas systems.
- Real-time operating constraints of electricity and natural gas systems.
- Wind power uncertainty is characterized by wind power scenarios.

The following model represents real-time operation. It is solved for a specific realization of wind power production.

### Balancing

**Minimize**  
Balancing electricity and natural gas cost.

**Subject to**

- Real-time operating constraints of electricity and natural gas systems.
- Wind power production is considered known.

### Model details

- The optimization models recast as MILP problems.
- Balancing actions are provided only by GFPPs.
- Power flow is modelled by DC approximation.
- A Taylor series expansion is used to linearize the constraints related to the natural gas network.
- A dynamic gas system with line pack is considered.

## Application Results

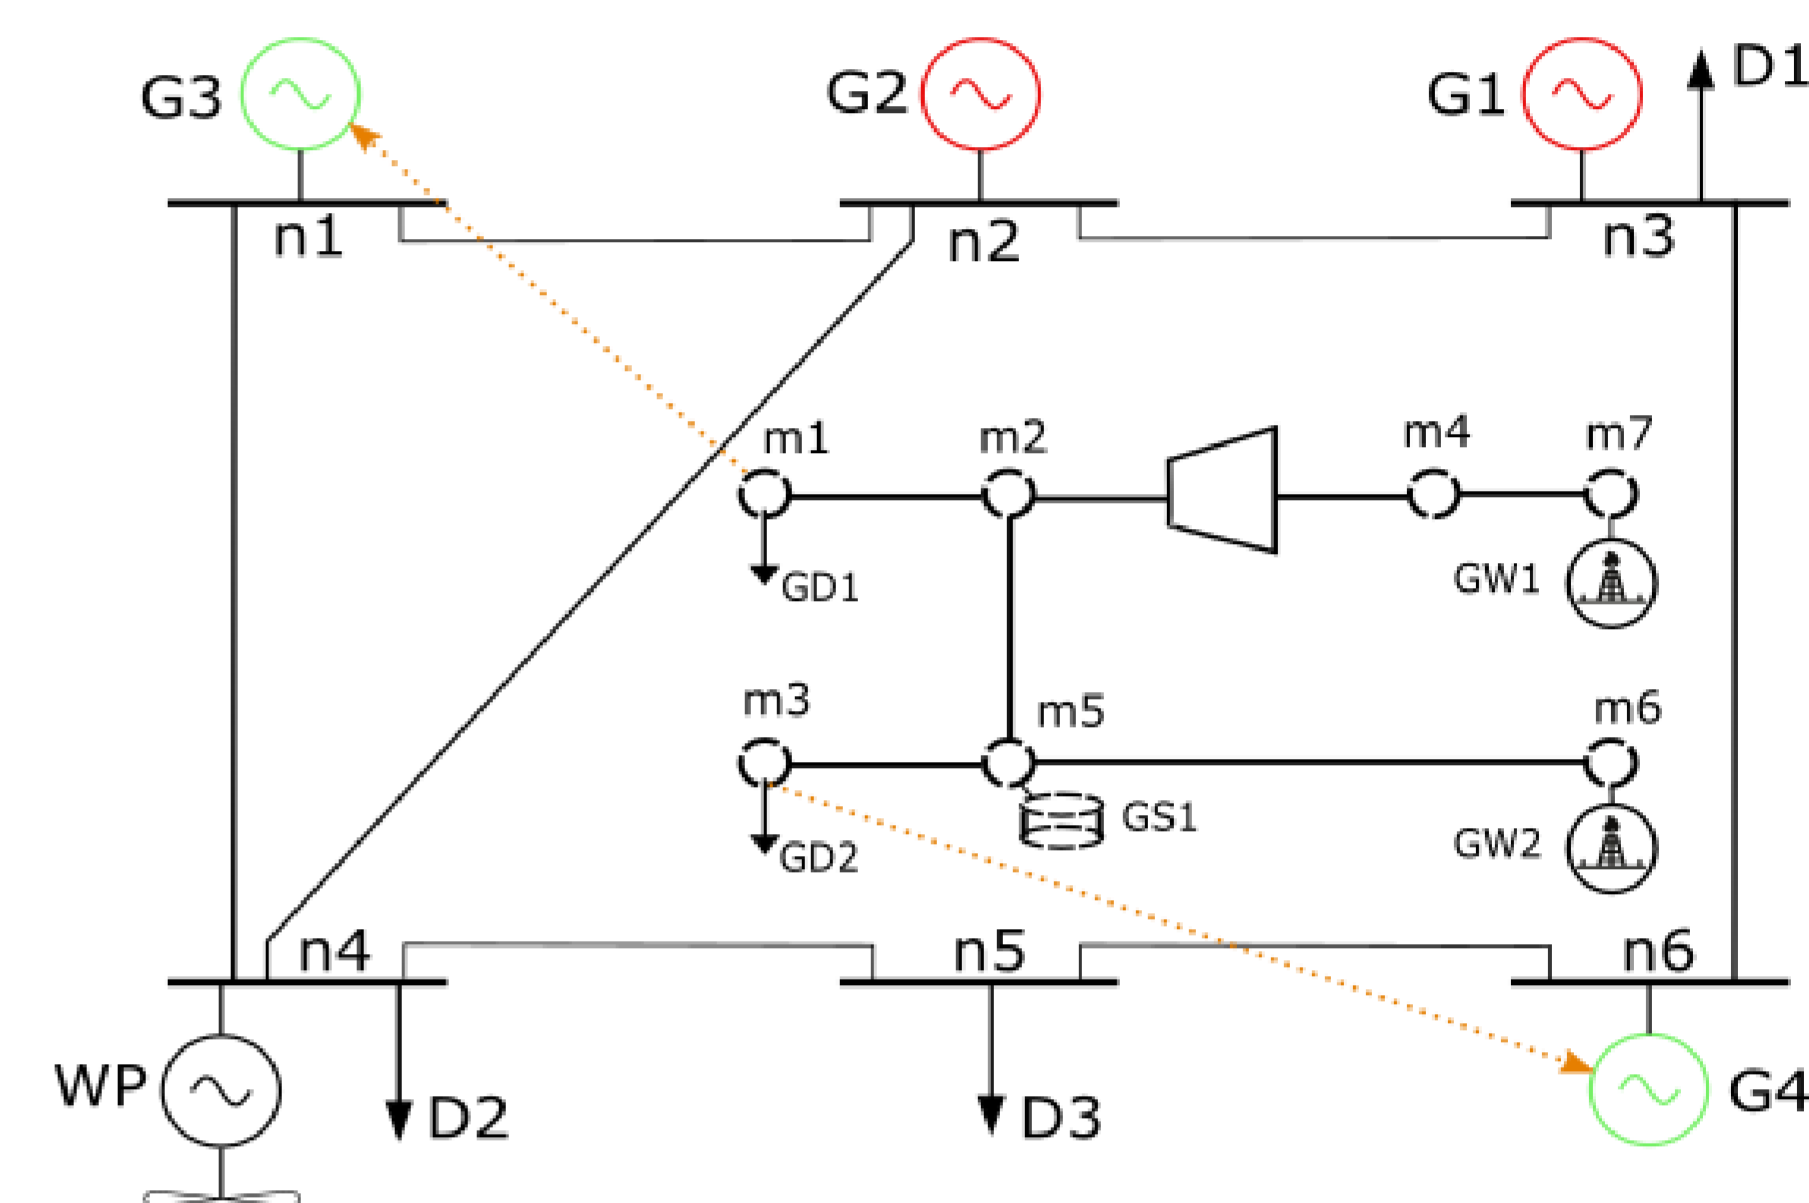


Fig. 1: Power and natural gas systems.

	$P_{max}$ (MW)	$R^{(+/-)}$ (MW)	$\eta$ (km <sup>3</sup> /MW)	$C$ (\$/MWh)
G1	100	0	-	20
G2	80	0	-	35
G3	60	60	0.205	-
G4	60	60	0.264	-
WP	200	-	-	0
	$G_{max}$ (km <sup>3</sup> )	Initial storage level (km <sup>3</sup> )	Max in/outflow rate (km <sup>3</sup> /h)	$C$ (\$/km <sup>3</sup> )
GW1	150	-	-	184
GW2	170	-	-	110
GS1	150	75	50	147
Max Electricity Load	280 MW		Max NG Load	192 km <sup>3</sup>

Table 1: Technical and economic data of generating units, natural gas suppliers and natural gas storage unit.

### Solution procedure

- Day-ahead dispatch of power and natural gas systems is determined. Models **Conv-Dec**, **Conv-Int** and **Stoch-Int** are solved and 10 wind power scenarios are given as input.
- In **Conv-Dec**, we introduce parameter  $k$  that helps us define the electricity marginal cost of GFPPs ( $C=k \cdot LMP_{gas} \cdot \eta$ ). The  $LMP_{gas}$  is determined from **Conv-Int** model.
- Given the day-ahead dispatch from (1), **balancing** model is evaluated for 30 different wind power realizations to determine the total operating cost.

Optimization model	Total cost (\$)	Relative to Stoch-Int (%)
Stoch-Int	558 726	-
Conv-Int	588 836	5.38
Conv-Dec ( $k=1$ )	588 836	5.38
Conv-Dec ( $k=1.1$ )	589 292	5.47
Conv-Dec ( $k=0.9$ )	591 815	5.92

Table 2: Total operating cost.

## Conclusions and Future Plans

- Integrating the operation of power and natural gas systems under stochastic market clearing results in a significant reduction of daily operating cost.
- The case of  $k=1$  reflects the case when GFPPs have perfectly foreseen the ideal natural gas price (i.e., the one stemming from Conv-Int model).
- It is noticed that the total operating cost further increases in the cases of  $k \neq 1$ .
- In future work, the introduction of CHP plants to cover heat demand will be examined, as well as power-to-gas technology.

## Acknowledgements

This research was funded by the CITIES project, Grant No. DSF 1305-00027B.