



## Alternative Layouts for the Carbon Capture with the Chilled Ammonia Process

**Valenti, Gianluca; Bonalumi, Davide; Fosbøl, Philip Loldrup; Macchi, Ennio; Thomsen, Kaj; Gatti, Dominicc**

*Published in:*  
Energy Procedia

*Publication date:*  
2013

*Document Version*  
Publisher's PDF, also known as Version of record

[Link back to DTU Orbit](#)

*Citation (APA):*

Valenti, G., Bonalumi, D., Fosbøl, P. L., Macchi, E., Thomsen, K., & Gatti, D. (2013). Alternative Layouts for the Carbon Capture with the Chilled Ammonia Process. *Energy Procedia*, 37, 2076-2083.

---

### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

GHGT-11

## Alternative layouts for the carbon capture with the Chilled Ammonia Process

Gianluca Valenti<sup>a,\*</sup>, Davide Bonalumi<sup>a</sup>, Philip Fosbøl<sup>b</sup>, Ennio Macchi<sup>a</sup>,  
Kaj Thomsen<sup>b</sup>, Domenico Gatti<sup>a</sup>

<sup>a</sup>Politecnico di Milano – Dipartimento di Energia, Via R. Lambruschini 4, Milano, Italy

<sup>b</sup>Technical University of Denmark – DTU Chemical Engineering – Center for Energy Resources Engineering, Building 229, 2800  
Lingby, Denmark

### Abstract

Many alternatives are being investigated for the carbon capture, but none appears to have been proved as the choice for full-scale applications. This work considers the Chilled Ammonia Process for coal-fired Ultra Super Critical power plants. Three layouts are simulated with Aspen Plus and the Extended UNIQUAC thermodynamic model. Compared to a traditional layout, stripping of the wash water of the absorber or, better, splitting the rich solution between the middle and the top of the column limits greatly the ammonia slip. Moreover, splitting the regeneration over two levels reduces substantially the electric loss due to stream extraction from the turbine. The simulations show that the net electric efficiency drops from 45.5% to 33.5-34.5%, the SPECCA index is 3.8-4.3 MJ<sub>th</sub> kg<sub>CO<sub>2</sub></sub><sup>-1</sup> and the heat duties are 2.7-2.9 MJ<sub>th</sub> kg<sub>CO<sub>2</sub></sub><sup>-1</sup>. The performances may improve greatly upon optimization of the parameters.

© 2013 The Authors. Published by Elsevier Ltd.  
Selection and/or peer-review under responsibility of GHGT

*Keywords:* carbon capture; chemical absorption; ammonia aqueous solution; chilled ammonia process; process layouts.

### 1. Introduction

Many alternatives are being investigated worldwide to capture, and then store, the carbon dioxide generated by the combustion of fossil fuels. Apparently none has been proved to be the choice for full-scale applications. This work considers the post-combustion chemical absorption via an aqueous solution of ammonia in chilled conditions, the Chilled Ammonia Process (CAP), applied to coal-fired Ultra Super Critical (USC) power plants. The scope is comparing three layouts with the software Aspen Plus (ver.7.3) employing a thermodynamic model that is not built inside the code but defined by the user.

\* Corresponding author. Tel.: +39-02-2399.3845; fax: +39-02-2399.3913.  
E-mail address: [gianluca.valenti@polimi.it](mailto:gianluca.valenti@polimi.it)

<b>Nomenclature</b>			
<i>Equipment abbreviations</i>			
AB	Absorber	ST	Stripper
AC	Air-cooler	WK	Water knockout
CC	Contact cooling tower	WT	Wash tower
CM	Compressor	<i>Acronyms</i>	
FGD	Flue gas desulfurization	CAP	Chilled Ammonia Process
FN	Fan	FGD	Flue Gas Desulfurization
HC	Hydrocyclone	USC	Ultra Super Critical
HX	Heat exchanger	<i>Symbols</i>	
PM	Pump	$\eta_{CO_2}$	Carbon capture efficiency [-]
PR	Purge	$\eta_e$	Net electrical efficiency [-]
RB	Reboiler	$E$	Specific CO <sub>2</sub> emission [kg <sub>CO2</sub> MWh <sub>e</sub> <sup>-1</sup> ]
RC	Recuperator	<i>SPECCA</i>	Specific Primary Energy Consumption for Carbon Avoided [MJ <sub>th</sub> kgCO <sub>2</sub> <sup>-1</sup> ]
RG	Regenerator	$q_{CO_2}$	Specific heat duty [MJ <sub>th</sub> kgCO <sub>2</sub> <sup>-1</sup> ]

The adopted thermodynamic model, namely the Extended UNIQUAC model, has been developed over the years at the Technical University of Denmark for diverse mixtures, including amines and ammonia solutions for the carbon capture. It has been tuned finely for reproducing phase equilibria and thermal properties of the CO<sub>2</sub>-NH<sub>3</sub>-H<sub>2</sub>O system [1-4]. On its side, Politecnico di Milano has been focusing mainly on plant schemes adopting a simplified thermodynamic model [5] or the Aspen Plus V7.2 built-in e-NRTL model [6,7]. The two universities have naturally joined in the study of post-combustion carbon capture via chemical absorption. At first, Darde et al. [8] have shown that the Extended UNIQUAC model is averagely more accurate than the e-NRTL model in reproducing equilibrium experimental data of the ternary system CO<sub>2</sub>-H<sub>2</sub>O-NH<sub>3</sub> over a wide range of temperatures, pressures and concentrations. The joint analysis covers here the comparison of capture processes that, as in the past, involve salt precipitation and that, consequently, are simulated with an equilibrium-stage approach.

## 2. Bibliographic review

The first conceptual scheme of a carbon dioxide chemical absorption with aqueous ammonia is likely that by Bai et Yeh (1997) [9]. It is a conventional scheme which is envisioned to have a water wash at the top of both the absorber and the regenerator because ammonia slip is already recognized as a possible problem. Resnik et al. (2004) [10] are probably the first investigators to suggest the use of ammonia solution for the multi-pollutant (CO<sub>2</sub>, SO<sub>2</sub>, NO<sub>x</sub>, HCl and HF) from the flue gases of fossil fuel-fired plants, an idea that is being pursued by Powerspan Corp [11]. In 2005 Gal patents the concept of conducting the absorption in chilled conditions (0-20°C) to favor the carbon dioxide capture and to limit the ammonia slip [12]. The company Alstom has licensed the exclusive, world-wide rights to market and sell the process patented by Gal [13]. Until about 2009 Alstom designs and operates a pilot plant based on the conventional absorption-regeneration scheme in which, though, the regeneration pressure is fairly high (20-40 bar). Subsequently, Alstom redesigns the layout modifying the way ammonia is recovered from the flue gas and implements it in a few test sites [14-16]. Strube and Manfrida (2011) [17] study a capture layout similar to this second Alstom scheme and compare its integration with different power plant types. Also starting from the later scheme by Alstom, Linnenberg et al. (2012) [18] develop two alternative arrangements of the absorption stage and analyze in detail the integration with the power plant. Finally, there is quite a number of patents deposited by Alstom that cover many modifications to its layouts, but to the knowledge of the authors there are no scientific publications about them yet.

### 3. Thermodynamic model and process layouts

The USC power plant equipped with the CAP is divided into two major blocks: (i) the power and (ii) the capture block. The power block is treated as a whole, whereas the capture block is subdivided into islands: (i) exhaust chilling, (ii) absorption-regeneration-gas wash, (iii) carbon dioxide compression, (iv) chilling plant, and (v) ammonia removal. Three layouts for the capture block are considered, differing primarily by the abs.-reg.-gas wash island. The ammonia removal island is not present in one layout because the ammonia slip is controlled at the absorption process. General parameters are given in Table 1.

#### *Extended UNIQUAC model*

The Extended UNIQUAC thermodynamic model for gas solubility in salt solutions was developed by Thomsen and Rasmussen (1999) [1]. It is derived from the original UNIQUAC expression by Abrams and Prausnitz (1975) [20] by adding a Debye-Hückel term to account additional excess Gibbs energy from the electrostatic interactions between ionic species. The model requires UNIQUAC volume and surface area parameters for each species, along with temperature-dependent binary interaction energy parameters for each pair of species. Phase equilibrium calculations are performed with the  $\gamma - \varphi$  approach coupled with equilibrium speciation reactions with potential solid phase precipitation. The liquid phase activity coefficients are calculated from the Extended UNIQUAC model, while the gas phase fugacity coefficients from the Soave-Redlich-Kwong equation of state. Besides phase relations, the model reproduces also thermal properties, such as enthalpy and entropy, within the experimental accuracy.

#### *Power block*

The effect of the steam extraction on the power generation is computed starting from a typical expansion curve of a low pressure turbine. The curve is assumed to be a straight segment connecting inlet and outlet of the turbine on an entropy-enthalpy diagram (Figure 2). The extraction pressure along the curve is determined by the regeneration temperature allowing for a minimal temperature difference in the reboiler. Prior to entering the reboiler, the steam is tempered with part of the liquid water exiting the reboiler itself. The extracted mass flow rate is defined by the energy balance over the reboiler for a given heat duty. The electric loss due to the steam extraction is computed as the power that would be generated by the extracted steam from the extraction state to the outlet state assuming that the expansion curve does not change. The integration of the exiting condensate with the power block, such as in the deaerator or in the pre-heating line, is not considered now. The condensate is instead directed to the condenser.

#### *Capture block*

Layout 1 is derived from the first plant proposed by Alstom [13] and based on a conventional absorption-regeneration scheme (Figure 1). Such scheme applied to CAP has the major issue of the ammonia slip through the treated flue gas requiring: (i) refrigeration, (ii) water wash and (iii) removal of remaining ammonia with an acid solution. The ammonia slip issue may be addressed at the design of both the absorber and the process. Regarding the absorber, Budzianowski [19] investigates numerically and, in part, experimentally three reactor configurations and shows that a number of parameter may be adjusted to control the vaporization of ammonia. Regarding the process, new schemes may be defined.

Layout 2 is the evolution of Layout 1 derived from the second plant by Alstom [14] (Figure 1). It aims at recovering the ammonia slip from the treated gas through a high-pressure and high-temperature thermal stripping of a small portion of the wash water of the absorber.

Layout 3 is a modification of Layout 1 that aims at controlling the ammonia slip, as Layout 2 but with another strategy, and the electric loss due to stream extraction (Figure 1). The ammonia slip is limited splitting the recycle of the rich solution between the top and the middle of the absorber; the electric loss is limited splitting the regeneration into two stages, one at low pressure and low temperature and the other at high pressure and moderate temperature. Pressures and temperatures are set imposing that the two compressors have same compression ratio and same inlet volume flow rates so that they are identical.

### *Performance indexes*

The carbon capture efficiency,  $\eta_{CO_2}$  [%] defined as the ratio of the flow rates [ $\text{kmol s}^{-1}$  or  $\text{kg s}^{-1}$ ] of the carbon dioxide exiting the compression island and that entering the exhaust chilling island, is one performance index. The second one is the specific heat duty,  $q_{CO_2}$  [ $\text{MJ}_{\text{th}} \text{kg}_{CO_2}^{-1}$ ], defined as the ratio of the reboiler heat duty [ $\text{MW}_{\text{th}}$ ] and the mass flow rate [ $\text{kg s}^{-1}$ ] of the captured carbon dioxide. However, the specific heat duty does not include the information on the capture efficiency nor on the temperature at which the heat duty is required (or in equivalent terms the loss of electric power from the steam turbine). Thus, here is adopted a third index, the Specific Primary Energy Consumption for Carbon Avoided (*SPECCA*) [ $\text{MJ}_{\text{th}} \text{kg}_{CO_2}^{-1}$ ], introduced by Campanari et al. [21] and in use by the authors [7,8]. As an indication, the *SPECCA* of a conventional MEA plant exceeds  $4 \text{ MJ kg}_{CO_2}^{-1}$  [22].

### *Design parameters*

The design parameters are: (i) ammonia initial concentration of the aqueous solution, (ii) ammonia-to-carbon dioxide ratio in the absorber, (iii) regeneration pressure, and (iv) regeneration temperature. The ammonia-to-carbon ratio in the absorber is the ratio of the ammonia moles entering the reactor through the lean solution and the carbon dioxide moles entering through the exhaust. For each layout the design parameters are varied to: (i) achieve the carbon capture efficiency  $\eta_{CO_2}$  of 90%, (ii) reduce the ammonia slip in the treated gas and in the compressed carbon dioxide respectively below  $100 \text{ mg m}^{-3}$  at normal condition and at 6% of  $O_2$  and below 5 ppm, both on a dry basis, and (iii) limit the lean solution flow rate. The chosen values are in Table 2. With respect to a previous work [7], which minimizes the *SPECCA*, the attention is here on the ammonia slip. In the future, an optimization will be conducted.

## **4. Results and discussion**

The ratio of the electric power loss due to the stream extraction from the turbine and the heat duty as a function of the regeneration temperature is depicted in Figure 2. At a temperature as low as  $80^\circ\text{C}$  a heat duty of  $1 \text{ MW}_{\text{th}}$  corresponds to a power loss of  $0.119 \text{ MW}_e$ . This loss grows rapidly to  $0.166$  at  $100^\circ\text{C}$ ,  $0.212$  at  $120^\circ\text{C}$  and  $0.256 \text{ MW}_e$  at  $140^\circ\text{C}$ . At the stripping temperature of  $200^\circ\text{C}$  it is already  $0.377 \text{ MW}_e$ .

Table 3 reports the results in terms of the electric power loss due to direct use by air-coolers, fans, compressors and pumps, or indirect use by heat exchangers (via the chilling plant) and reboilers (via the extracted steam). The exhausts chilling island is identical for all layouts and consumes the least amount. Air-coolers and pumps of the absorption-regeneration-gas wash island sum to a relatively small portion of the consumptions, especially for Layout 2 that has small flow rates due to higher ammonia concentrations. Heat duties and chilling loads account for most of the losses. Layout 2 shows the lowest loss due to chilling thanks to a reduce load on the recycle of the rich solution. In addition, Layout 2 and, in particular, Layout 3 prove a greatly reduced loss due to the steam extraction. On top of this, Layout 3 allows to control effectively the ammonia slip as demonstrated by the smallest consumption for the pump of the water wash of the absorber (PM23 in Figure 1) and the absence of the ammonia removal island.

Losses are between 180 and 200 MW<sub>e</sub> for a USC plant of 754 MW<sub>e</sub> (Table 4). The net electrical efficiency goes from 45.5% to about 33.5-34.5%. *SPECCA* values are higher than a previous work [7]: Darde et al. [8] show that performances simulated with the Extended UNIQUAC model, as here, are worse than with the e-NRTL model, as before. Furthermore, the design parameters must be optimized.

Table 1. General parameters.

Parameter	Unit	Value	Parameter	Unit	Value
<i>Air coolers</i>			<i>Heat exchangers</i>		
Fluid end temperature	°C	25	Minimum temperature difference	°C	5
Relative pressure drop	%	1	<i>Low pressure steam turbine</i>		
Specific electric consumption	MW <sub>e</sub> MW <sub>th</sub> <sup>-1</sup>	0.0159	Inlet pressure	bar	4.5
<i>Ambient air</i>			Inlet temperature	°C	306
Temperature	°C	15	Outlet pressure	bar	0.05
<i>Chilling plant</i>			Outlet vapor title	%	93
Coefficient of performance	MW <sub>th</sub> MW <sub>e</sub> <sup>-1</sup>	5	Outlet velocity	m s <sup>-1</sup>	250
Specific electric consumption	MW <sub>e</sub> MW <sub>th</sub> <sup>-1</sup>	0.20	Generator efficiency	%	98
<i>Columns</i>			<i>Motors</i>		
Contact cooler pressure drop	bar	0.01	Electro-mechanical efficiency	%	95
Other column pressure drop	bar	0.03	<i>Pumps</i>		
<i>Compressors</i>			Hydraulic efficiency	%	85
Isentropic efficiency	%	85	<i>Reboiler</i>		
Last compressor end pressure	bar	80	Steam superheated temperature	°C	5
<i>Fans</i>			Steam subcooled temperature	°C	0
Forced fan end pressure	bar	1.08	<i>Reference power plant [22 Sec. 3.2]</i>		
Induced fan end pressure	bar	1.04	Net electric power	MW <sub>e</sub>	754
Isentropic efficiency	%	90	Net electrical efficiency, $\eta_{e,REF}$	%	45.5
<i>Exhausts [22 Sec. 3.2]</i>			Specific CO <sub>2</sub> emission, $E_{REF}$	kgCO <sub>2</sub> MWh <sub>e</sub> <sup>-1</sup>	763
Mass flow rate	kg s <sup>-1</sup>	782	<i>Pipeline</i>		
Pressure	bar	1.04	Delivery pressure	bar	110
Temperature	°C	50	<i>Targets</i>		
Composition:	% (vol. wet)		Carbon capture efficiency, $\eta_{CO_2}$	%	90
CO <sub>2</sub>		13.73	Max ammonia slip (vol. dry)		
Inert (Ar, N <sub>2</sub> , O <sub>2</sub> )		76.54	Treated gas	mg Nm <sup>-3</sup> <sub>6%O<sub>2</sub></sub>	100
H <sub>2</sub> O		9.73	Compressed carbon dioxide	mg Nm <sup>-3</sup>	10

Table 2. Adopted design parameters.

Parameter	Unit	Layout 1	Layout 2	Layout 3
Ammonia initial concentration	%wt	0.1	0.2	0.1
Ammonia-to-carbon dioxide ratio	kmol kmol <sup>-1</sup>	3.1	3.2	3.1
Regeneration pressure	bar	20	20	10.7/29.3
Regeneration temperature	°C	110	102/204	69/120

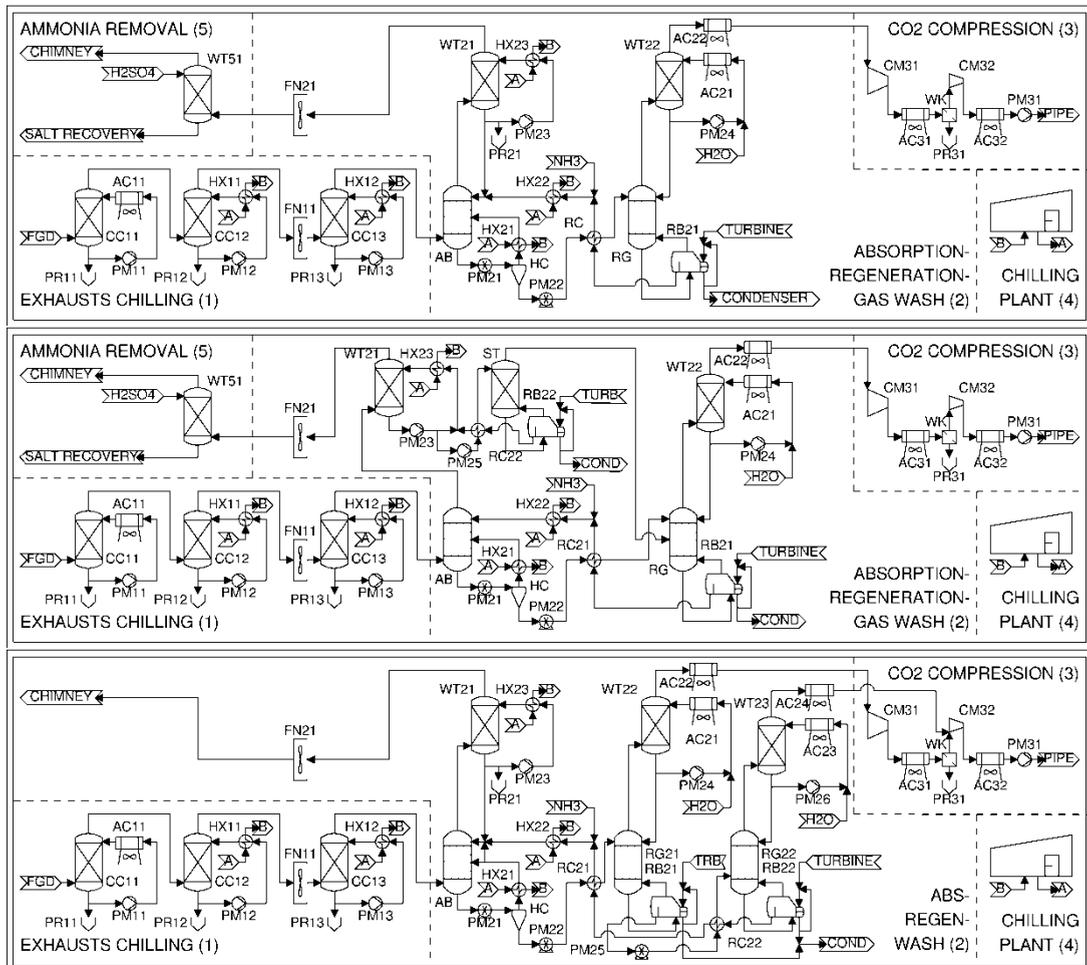


Figure 1. The three layouts considered in this work. From top to bottom: Layout 1, Layout 2 and Layout 3.

## 5. Conclusions

Three layouts for the carbon capture with the Chilled Ammonia Process (CAP) are compared yielding the following conclusions.

- The ammonia slip is a major issue, but it can be controlled at the process level by either stripping the water wash or, better, by splitting the rich solution between the top and the middle of the absorber.
- Heat duty is the greatest source of electrical loss by way of steam extracted by the turbine, but it may be effectively mitigated by splitting the regeneration process into a low and a high pressure stage.
- CAP is predicted to reduce the net electric efficiency of an USC plant from 45.5% to about 33.5-34.5%, while the SPECCA is  $3.8\text{--}4.3 \text{ MJ}_{\text{th}} \text{ kg}_{\text{CO}_2}^{-1}$  and heat duties  $2.7\text{--}2.9 \text{ MJ}_{\text{th}} \text{ kg}_{\text{CO}_2}^{-1}$ .
- Indexes computed in this work are less promising than in previous studies because the Extended UNIQUAC model is expected to be more accurate but less optimistic than the e-NRTL model, built-in inside Aspen Plus, and because the design parameters must be optimized.
- The design parameter optimization must be constrained to limit the ammonia slip.

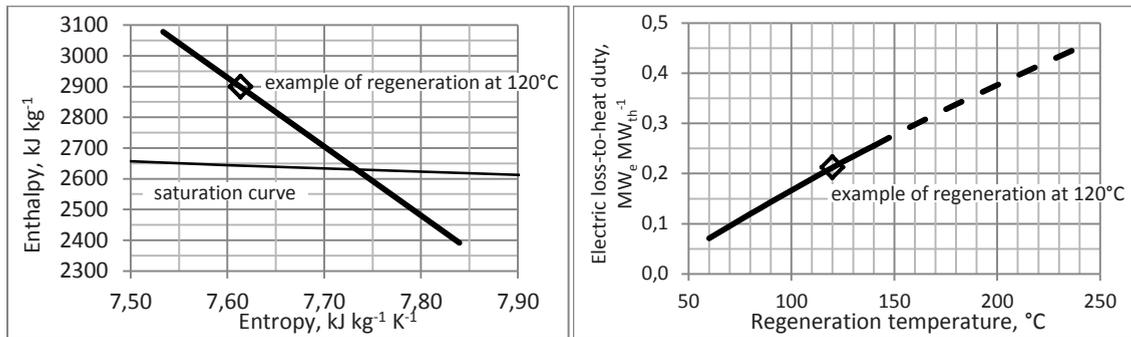


Figure 2. Left: expansion curve in the enthalpy-entropy diagram of the low pressure turbine from which the steam is extracted. Right: ratio of electrical loss-to-heat duty as a function of regeneration temperature (above 140°C the curve is extrapolated because the computed pressure is higher than the inlet pressure). The diamond shows an example of a regeneration temperature at 120°C.

The next stage will consider capturing the slipped ammonia to produce fertilizers and employing a Ljungström heat exchanger to recuperate heat. Moreover, the complete plants will be also optimized.

## References

- [1] Thomsen K and Rasmussen P. Modeling of Vapor-liquid-solid equilibrium in gas-aqueous electrolyte systems. *Chemical Engineering Science* 1999;**54**:1787-802.
- [2] Darde V, van Well WJM, Stenby EH, Thomsen K. Modeling of Carbon Dioxide Absorption by Aqueous Ammonia Solutions Using the Extended UNIQUAC Model. *Ind Eng Chem Res* 2010;**49**:12663-74.
- [3] Darde V, van Well WJM, Fosbøl P, Stenby EH, Thomsen K. Experimental measurement and modeling of the rate of absorption of carbon dioxide by aqueous ammonia. *Int J Greenhouse Gas Control* 2011;**5**:1149-62.
- [4] Darde V, Maribo-Mogensen B, van Well WJM, Stenby EH, Thomsen K. Process simulation of CO<sub>2</sub> capture with aqueous ammonia using the Extended UNIQUAC model. *Int J Greenhouse Gas Control* 2012;**10**:74–87.
- [5] Valenti G, Bonalumi D, Macchi E. Energy and exergy analyses for the carbon capture with the Chilled Ammonia Process (CAP). *Energy Procedia* 2009;**1**:1059–66.
- [6] Valenti G, Bonalumi D, Macchi E. Modeling Ultra Super Critical power plants integrated with the Chilled Ammonia Process. *Energy Procedia* 2011;**4**:1721–8.
- [7] Valenti G, Bonalumi D, Macchi E. A parametric investigation of the Chilled Ammonia Process from energy and economic perspectives. *Fuel* 2012;**101**:74–83.
- [8] Darde V, Thomsen K, van Well WJM, Bonalumi D, Valenti G, Macchi E. Comparison of two electrolyte models for the carbon capture with aqueous ammonia. *Int J Greenhouse Gas Control* 2012;**8**:61-72.
- [9] Bai H, Yeh AC. Removal of CO<sub>2</sub> greenhouse gas by ammonia scrubbing. *Ind Eng Chem Res* 1997;**36**:2490-3.
- [10] Resnik KP, Yeh JT, Pennline HW. Aqua ammonia process for simultaneous removal of CO<sub>2</sub>, SO<sub>2</sub> and NO<sub>x</sub>. *Int J Env Tech Managment* 2004;**4**:89-104. doi:10.1504/IJETM.2004.004634
- [11] McLarnon CR, Ducan JL. Testing of ammonia based CO<sub>2</sub> Capture with Multi-Pollutant Control Technology. *Energy Procedia* 2009;**1**:1024-34. doi:10.1016/j.egypro.2009.01.136
- [12] Gal E. Ultra cleaning of combustion gas including the removal of CO<sub>2</sub>. *Patent*. PCT/US2005/012794
- [13] Black S, Bade O-M, Gal E, Morris E, Krishnan G, Jayaweera IS. Chilled ammonia process for CO<sub>2</sub> capture. *In proceedings of Power-Gen Europe*, Madrid, Spain, 2007.
- [14] Sherrick B, Hammond M, Spitznogle G, Muraskin D, Black S, Cage M. CCS with Alstom's Chilled Ammonia Process at AEP's Mountaineer plant. *In proceedings of MEGA Conference*, Baltimore, Maryland, USA, 2008.
- [15] Black J, Kozak F, Leadri J-F, Muraskin D, Cage M, Sherrick B, et al. CCS project: Chilled Ammonia process at the AEP Mountaineer Plant. *In proceedings of COAL-GEN*, Pittsburgh, PA, USA, 2010.
- [16] Bolliger R, Hammond M, Spitznogle G, Sherrick B, Muraskin D, Kozak F, Cage M, Varner M. CCS Project: Chilled Ammonia Process at the AEP Mountaineer Plant. *In proceedings of COAL-GEN*, Columbus, OH, USA, 2011.
- [17] Strube R, Manfrida G. CO<sub>2</sub> capture in coal-fired power plants – Impact on plant performance. *Int J Greenhouse Gas Control* 2011;**5**:710-26. doi:10.1016/j.ijggc.2011.01.008

- [18] Linnenberg S, Darde V, Oexmann J, Kather A, van Well WJM, Thomsen K. Evaluating the impact of an ammonia-based post-combustion CO<sub>2</sub> capture process on a steam power plant with different cooling water temperatures. *Int J Greenhouse Gas Control* 2012;10:1-14. doi:10.1016/j.ijggc.2012.05.003
- [19] Budzianowski WM. Mitigating NH<sub>3</sub> Vaporization from an Aqueous Ammonia Process for CO<sub>2</sub> Capture. *Int J Chem Reactor Eng* 2011;9:1-27.
- [20] Abrams DS, Prausnitz JM, Statistical Thermodynamics of Liquid Mixtures: A new expression for the Excess Gibbs Energy of Partly or Completely Miscible Systems. *AIChE Journal* 1975;21:116-28.
- [21] Campanari S, Chiesa P, Manzolini G. CO<sub>2</sub> capture from combined cycles integrated with Molten Carbonate Fuel Cells. *Int J Greenhouse Gas Control* 2010;4:441-51.
- [22] European Benchmarking Task Force. D 4.9 European best practise guidelines for assessment of CO<sub>2</sub> capture technologies.2011.

Table 3. Electric power loss due to direct (air-coolers, compressors, fans, pumps) and indirect use (heat exchangers, reboilers).

Electric power, MW <sub>e</sub>	Layout 1	Layout 2	Layout 3	Electric power, MW <sub>e</sub>	Layout 1	Layout 2	Layout 3
<i>Exhaust chilling</i>				<i>Carbon dioxide compression</i>			
AC11	1.63	1.63	1.63	AC31	0.16	0.16	0.11
FN11	3.79	3.79	3.79	AC32	0.53	0.53	0.62
PM11	0.21	0.21	0.21	CM31	6.85	6.82	5.51
PM12	0.14	0.14	0.14	CM32	6.16	6.14	9.91
PM13	0.03	0.03	0.03	PM31	0.77	0.77	0.77
Subtotal	5.80	5.80	5.80	Subtotal	14.48	14.42	16.92
<i>Absorption-Regeneration-Wash</i>				<i>Chilling plant</i>			
AC21	0.10	0.11	0.03	HX11	7.88	7.88	7.88
AC22	0.06	0.02	0.00	HX12	0.81	0.81	0.81
AC23	0.00	0.00	0.19	HX21	53.46	49.36	54.39
AC24	0.00	0.00	0.01	HX22	26.08	26.99	29.50
PM21	1.12	0.57	1.12	HX23	3.29	1.94	1.08
PM22	4.72	2.70	2.29	Subtotal	91.52	86.98	93.65
PM23	3.81	0.97	2.26	<i>Power block</i>			
PM24	0.40	0.07	0.06	RB21	77.60	62.16	28.61
PM25	0.00	0.20	5.18	RB22	0.00	10.97	26.17
PM26	0.00	0.00	0.08	Subtotal	77.60	73.13	54.78
Subtotal	10.21	4.64	11.23	Total of electric power losses	199.61	184.98	182.38

Table 4. Electric performance of the reference plant [22 Sec. 3.2] and the considered layouts.

Parameter	Unit	Reference	Layout 1	Layout 2	Layout 3
Electric power loss	MW <sub>e</sub>	NA	200	185	182
Net electrical power	MW <sub>e</sub>	754	555	569	572
Net electrical efficiency, $\eta_e$	%	45.5	33.5	34.3	34.5
Capture efficiency, $\eta_{CO_2}$	%	NA	90.5	90.2	89.9
Specific CO <sub>2</sub> emission, $E$	kg <sub>CO2</sub> MWh <sub>e</sub> <sup>-1</sup>	763	98.6	99.5	101.5
Specific heat duty	MJ <sub>th</sub> kg <sub>CO2</sub> <sup>-1</sup>	NA	2.80	2.48/0.19	2.09/0.85
<i>SPECCA</i>	MJ <sub>th</sub> kg <sub>CO2</sub> <sup>-1</sup>	NA	4.3	3.9	3.8